

220V Wiring Diagram

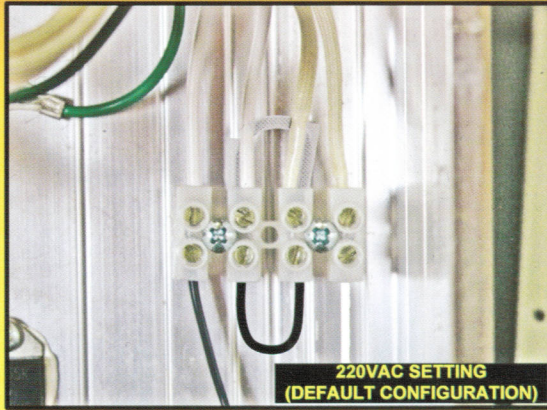


Figure 3 – 220 VAC Configuration

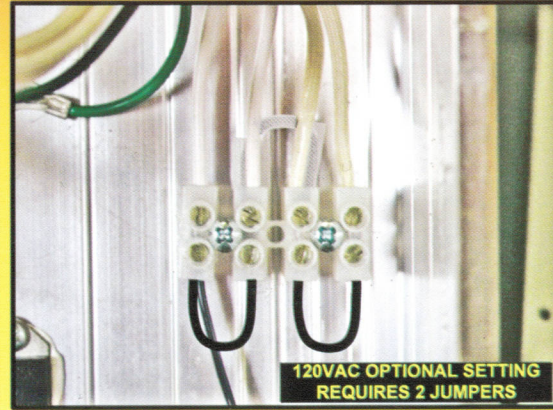


Figure 4 – 120 VAC Configuration

— Terminal Block is located on the right side of the Control Center —

**This conversion must be made
by a Certified Electrician
or Pool Professional.**

Recommended Water Chemistry

Salt:	4,000-4,500 ppm
pH:	7.2-7.6 ppm
Total Alkalinity:	80-100 ppm
Cyanuric Acid:	40-60 ppm
Calcium Hardness:	200-400 ppm
Metals (Phosphates, Nitrates):	None